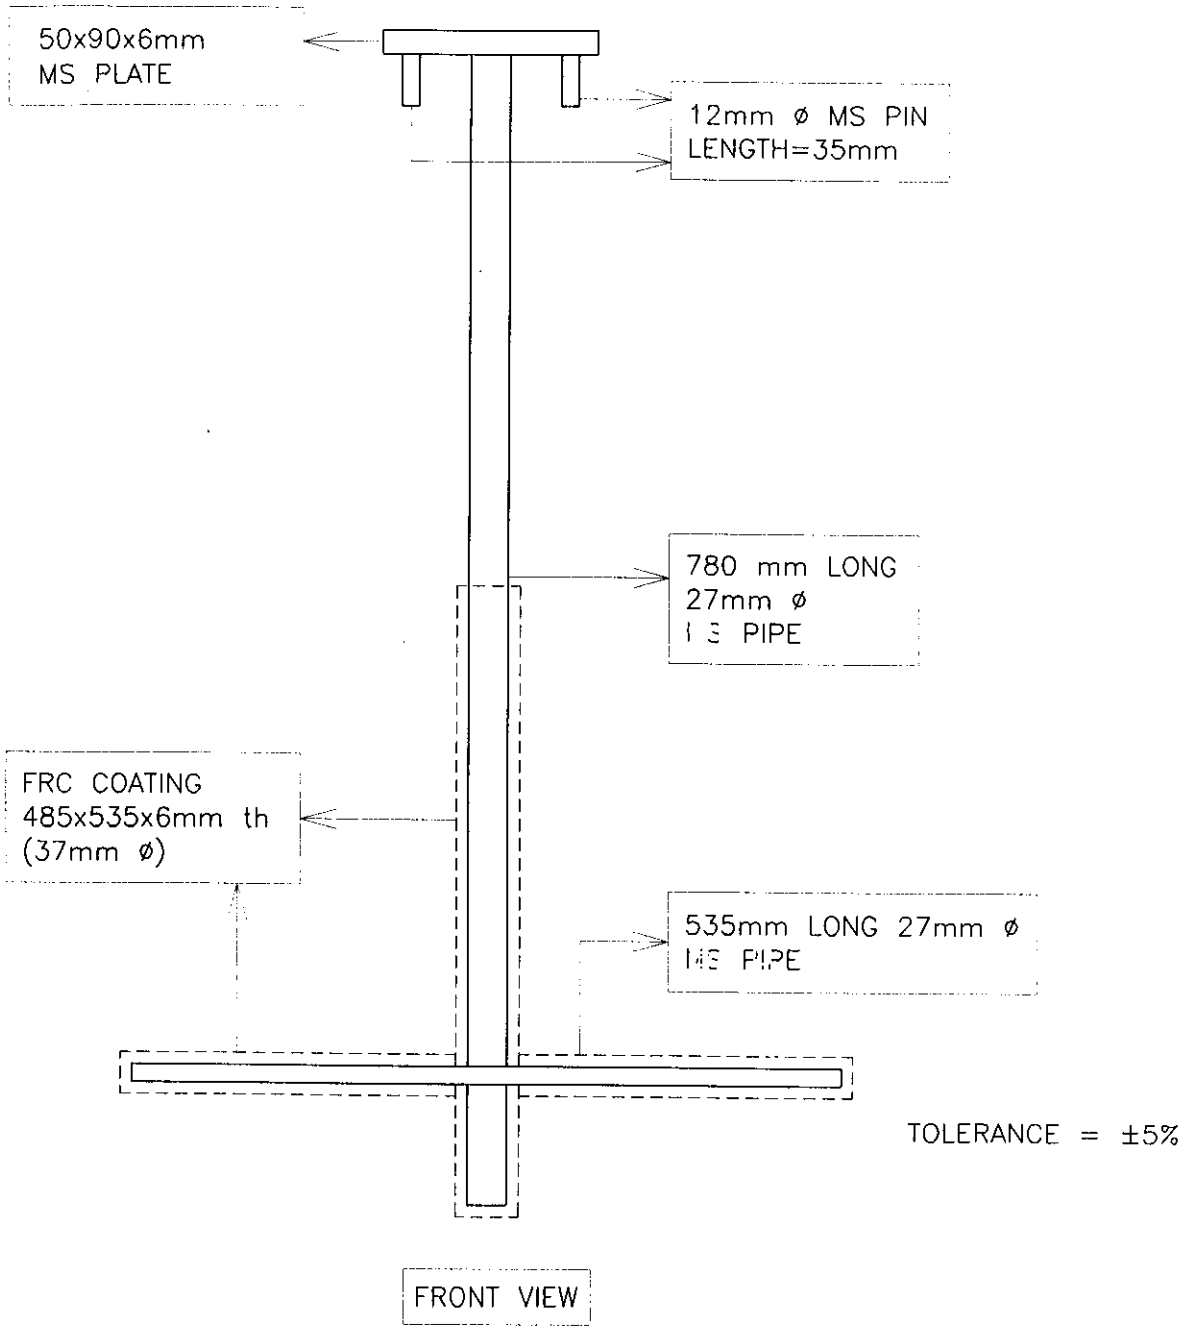

The Typical Insulated 11kV GOS operating Rod reference only

	Signatures	All dimensions ore in mm unless otherwise stated.	BESCOM
Chd	AGM (QS&S)	INSULATED GOS OPERATING ROD	Approved: General Manager,(Elec.) QS&S
Sub	DGM (QS&S)		
SCALE: N.T.S			DRG.NO.BESCOM/GM/QS&S/54 REV–002R1 DATED:24–11–2018